





## AUBURN FIRE DEPARTMENT KNOXBOX ACCESS


1. Go to knoxbox.com and click on the BUY button.

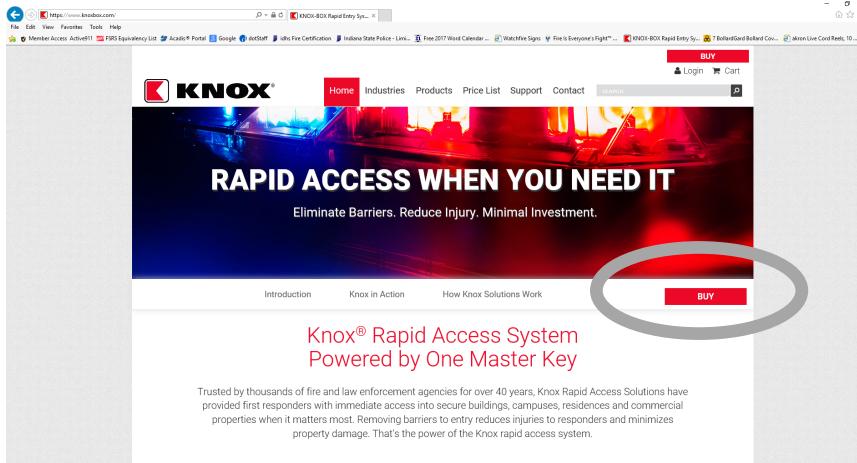

2. In the “Enter department name” box, type “Auburn” and then click on Submit button.

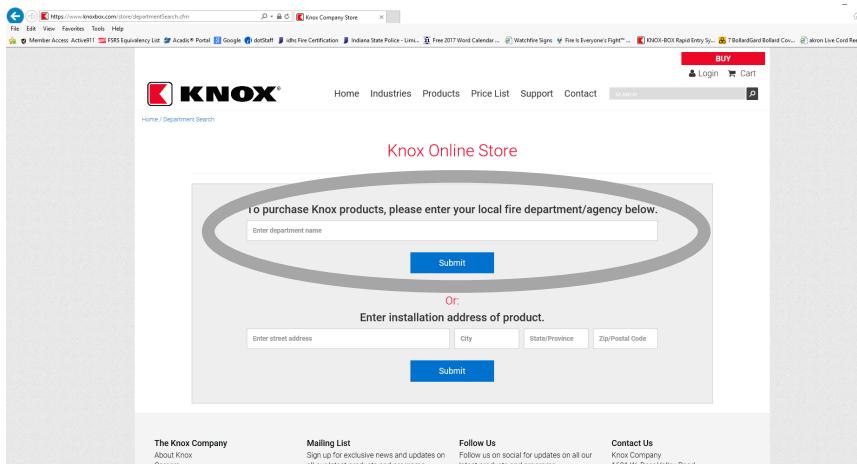

3. Select “Auburn Fire Dept Auburn, IN 46706” to purchase items. (3200 series)

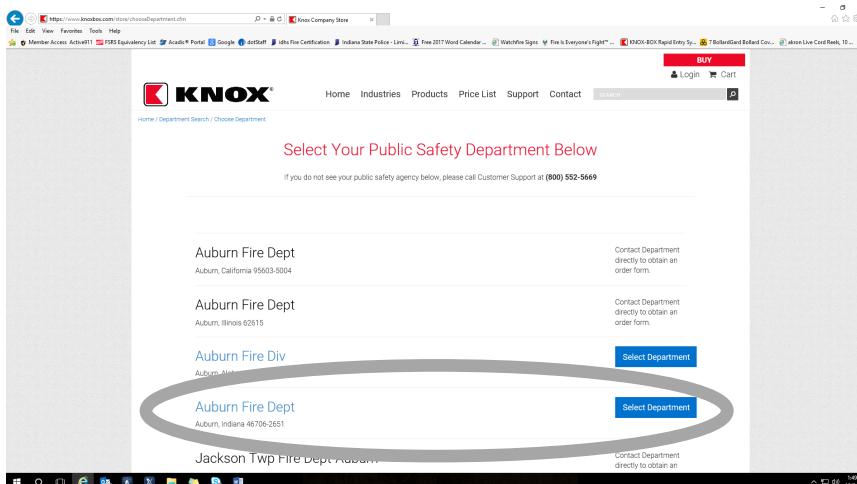

## **AUBURN FIRE PREVENTION CODE ORDINANCE 2004-003**

### **506.1 KEY BOX-WHEN REQUIRED**

Whenever the servicing fire department has instituted a key box emergency access system, a key box compatible with that system shall be installed in an accessible location if:

- 1) The building is protected with an automatic sprinkler system equipped with a local or transmitted water-flow alarm, or
- 2) The building is provided with any fire alarm system equipped with an outside audible/visual signaling device, or
- 3) The building is provided with any fire alarm system where the alarm is transmitted to an off-site location, or to the fire alarm center for the servicing fire department.

### **506.2 RESPONSIBILITY FOR KEY BOX**

Key boxes are to be provided by the building owner and shall contain such keys necessary to access all protected areas of the building. Multi-tenant buildings may share an owner provided box, and the building owner shall assume responsibility for insuring that keys are updated as appropriate. Tenant-provided boxes may not be shared with any other tenant, and the tenant assumes responsibility for key updates for the subject tenant space.

**EXCEPTION:** Key boxes for apartment houses are not required to contain keys to individual apartment dwelling

### **506.3 EXISTING BUILDINGS**

When a design release is issued by the office of the state building commissioner or a permit by local government when a design release is not required for construction, buildings constructed prior to April 30, 1998 shall not be required to provide a key box or key boxes under this section. Any new tenancy within space previously occupied by a different tenant shall require that a key box be provided in accordance with Sections 506.1 and 506.2. Existing buildings required to install a key box or key boxes by this section shall not be in violation of this section until (1) year after the effective date of this code.

(675 IAC 22-2.3-53) EFF: May 17, 2003

(Key boxes shall be mounted near the main entrance to the structure and at a mounting height of between 48 inches and 60 inches.)